



Sun™ Rack Service Manual

Sun Microsystems, Inc.
4150 Network Circle
Santa Clara, CA 95054 U.S.A.
650-960-1300

Part No. 816-6387-10
November 2002, Revision A

Send comments about this document to: docfeedback@sun.com

Copyright 2002 Sun Microsystems, Inc., 4150 Network Circle, Santa Clara, California 95054, U.S.A. All rights reserved.

Sun Microsystems, Inc. has intellectual property rights relating to technology embodied in the product that is described in this document. In particular, and without limitation, these intellectual property rights may include one or more of the U.S. patents listed at <http://www.sun.com/patents> and one or more additional patents or pending patent applications in the U.S. and in other countries.

This document and the product to which it pertains are distributed under licenses restricting their use, copying, distribution, and decompilation. No part of the product or of this document may be reproduced in any form by any means without prior written authorization of Sun and its licensors, if any.

Third-party software, including font technology, is copyrighted and licensed from Sun suppliers.

Parts of the product may be derived from Berkeley BSD systems, licensed from the University of California. UNIX is a registered trademark in the U.S. and in other countries, exclusively licensed through X/Open Company, Ltd.

Sun, Sun Microsystems, the Sun logo, AnswerBook2, docs.sun.com, and Solaris are trademarks or registered trademarks of Sun Microsystems, Inc. in the U.S. and in other countries.

All SPARC trademarks are used under license and are trademarks or registered trademarks of SPARC International, Inc. in the U.S. and in other countries. Products bearing SPARC trademarks are based upon an architecture developed by Sun Microsystems, Inc.

The OPEN LOOK and Sun™ Graphical User Interface was developed by Sun Microsystems, Inc. for its users and licensees. Sun acknowledges the pioneering efforts of Xerox in researching and developing the concept of visual or graphical user interfaces for the computer industry. Sun holds a non-exclusive license from Xerox to the Xerox Graphical User Interface, which license also covers Sun's licensees who implement OPEN LOOK GUIs and otherwise comply with Sun's written license agreements.

Use, duplication, or disclosure by the U.S. Government is subject to restrictions set forth in the Sun Microsystems, Inc. license agreements and as provided in DFARS 227.7202-1(a) and 227.7202-3(a) (1995), DFARS 252.227-7013(c)(1)(ii) (Oct. 1998), FAR 12.212(a) (1995), FAR 52.227-19, or FAR 52.227-14 (ALT III), as applicable.

DOCUMENTATION IS PROVIDED "AS IS" AND ALL EXPRESS OR IMPLIED CONDITIONS, REPRESENTATIONS AND WARRANTIES, INCLUDING ANY IMPLIED WARRANTY OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE OR NON-INFRINGEMENT, ARE DISCLAIMED, EXCEPT TO THE EXTENT THAT SUCH DISCLAIMERS ARE HELD TO BE LEGALLY INVALID.

Copyright 2002 Sun Microsystems, Inc., 4150 Network Circle, Santa Clara, California 95054, Etats-Unis. Tous droits réservés.

Sun Microsystems, Inc. a les droits de propriété intellectuels relatants à la technologie incorporée dans le produit qui est décrit dans ce document. En particulier, et sans la limitation, ces droits de propriété intellectuels peuvent inclure un ou plus des brevets américains énumérés à <http://www.sun.com/patents> et un ou les brevets plus supplémentaires ou les applications de brevet en attente dans les Etats-Unis et dans les autres pays.

Ce produit ou document est protégé par un copyright et distribué avec des licences qui en restreignent l'utilisation, la copie, la distribution, et la décompilation. Aucune partie de ce produit ou document ne peut être reproduite sous aucune forme, par quelque moyen que ce soit, sans l'autorisation préalable et écrite de Sun et de ses bailleurs de licence, s'il y en a.

Le logiciel détenu par des tiers, et qui comprend la technologie relative aux polices de caractères, est protégé par un copyright et licencié par des fournisseurs de Sun.

Des parties de ce produit pourront être dérivées des systèmes Berkeley BSD licenciés par l'Université de Californie. UNIX est une marque déposée aux Etats-Unis et dans d'autres pays et licenciée exclusivement par X/Open Company, Ltd.

Sun, Sun Microsystems, le logo Sun, AnswerBook2, docs.sun.com, et Solaris sont des marques de fabrique ou des marques déposées de Sun Microsystems, Inc. aux Etats-Unis et dans d'autres pays.

Toutes les marques SPARC sont utilisées sous licence et sont des marques de fabrique ou des marques déposées de SPARC International, Inc. aux Etats-Unis et dans d'autres pays. Les produits portant les marques SPARC sont basés sur une architecture développée par Sun Microsystems, Inc.

L'interface d'utilisation graphique OPEN LOOK et Sun™ a été développée par Sun Microsystems, Inc. pour ses utilisateurs et licenciés. Sun reconnaît les efforts de pionniers de Xerox pour la recherche et le développement du concept des interfaces d'utilisation visuelle ou graphique pour l'industrie de l'informatique. Sun détient une licence non exclusive de Xerox sur l'interface d'utilisation graphique Xerox, cette licence couvrant également les licences de Sun qui mettent en place l'interface d'utilisation graphique OPEN LOOK et qui en outre se conforment aux licences écrites de Sun.

LA DOCUMENTATION EST FOURNIE "EN L'ÉTAT" ET TOUTES AUTRES CONDITIONS, DECLARATIONS ET GARANTIES EXPRESSES OU TACITES SONT FORMELLEMENT EXCLUES, DANS LA MESURE AUTORISÉE PAR LA LOI APPLICABLE, Y COMPRIS NOTAMMENT TOUTE GARANTIE IMPLICITE RELATIVE A LA QUALITE MARCHANDE, A L'APTITUDE A UNE UTILISATION PARTICULIERE OU A L'ABSENCE DE CONTREFAÇON.



Contents

- 1. Sun Rack Service 1**
 - Preparing the Rack for Service 1
 - Removing the Grounding Straps 1
 - Removing a Side Panel 3
 - Removing an Extension Panel 4
 - Removing the Top Panel 4
 - Removing and Replacing a Power Sequencer 5
 - Removing and Replacing a Power Strip 6
 - Removing and Replacing a Cable Assembly 7
 - Removing a Cable Assembly 7
 - Replacing a Cable Assembly 8

- 2. Troubleshooting 13**
 - Power Sequencer 13
 - Power Strips 16

Preface

This document describes how to remove and replace the field replaceable parts in a Sun Rack and contains some troubleshooting information for isolating faults.

Accessing Sun Documentation

You can view, print, or purchase a broad selection of Sun documentation, including localized versions, at:

<http://www.sun.com/documentation>

Sun Welcomes Your Comments

Sun is interested in improving its documentation and welcomes your comments and suggestions. You can email your comments to Sun at:

docfeedback@sun.com

Please include the part number (816-6387-10) of your document in the subject line of your email.

Sun Rack Service

All service procedures must be performed by qualified service personnel.

Read the *Sun Rack Safety and Compliance* document before attempting any service procedures.

There are four types of field-replaceable units in the Sun™ Rack:

- Power sequencers
- Power strips
- Cable harnesses
- Top panel

Preparing the Rack for Service

Some maintenance tasks require that the panels be removed from the Sun Rack.

Removing the Grounding Straps

There are three grounding straps mounted to each corner of the top of the rack frame. FIGURE 1-1 and TABLE 1-1 identify which straps are connected to which panels. Before removing any panel, the grounding strap must be disconnected from the panel.

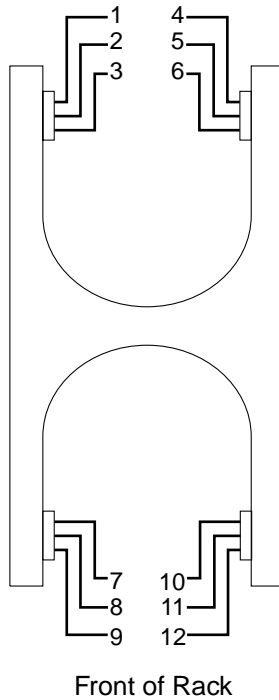


FIGURE 1-1 Top View of Rack Frame Showing Grounding Strap Terminals

TABLE 1-1 Grounding Strap Connections

Rack Terminal	Grounding Strap Number	Connected to:
Rear Left	1	Left extension panel
	2	Left side panel
	3	Rear door if hinged on left
Rear Right	4	Right extension panel
	5	Top panel
	6	Rear door if hinged on right
Front Left	7	Front door if hinged on left
	8	not used
	9	not used

TABLE 1-1 Grounding Strap Connections

Rack Terminal	Grounding Strap Number	Connected to:
Front Right	10	Right side panel
	11	Front door if hinged on right
	12	not used

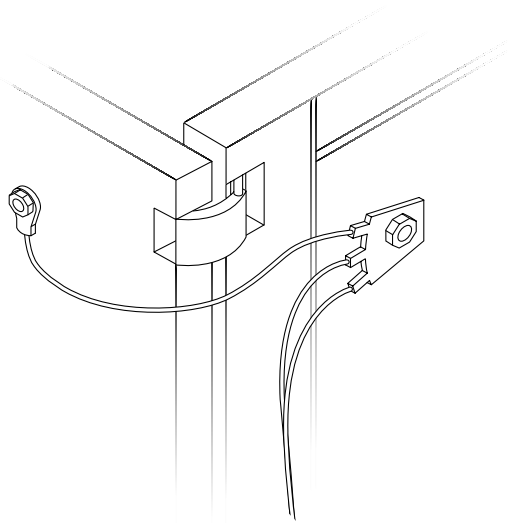


FIGURE 1-2 Typical Grounding Strap Connection

Removing a Side Panel

- 1. Disconnect the grounding strap from the stud on the top inside of the panel.**
- 2. Release two latches on the bottom inside of the panel.**
- 3. Pull the bottom of the panel slightly away from the rack and lift up the panel.**

Removing an Extension Panel

1. **Disconnect the grounding strap from the stud on the top inside of the panel.**
2. **Lift the panel up slightly and slide it toward the front of the rack.**

To hold the panel in place, a tab attached to the panel slides into a bracket on the rack side. There are two of these tabs and brackets, one at the top of the panel and one at the bottom.

Removing the Top Panel

1. **Disconnect the grounding strap from the stud on the top inside of the panel.**
2. **Disconnect the top panel power supply power cord from power strip.**
3. **Remove the logo panel from the top front of the rack, or if your Sun Rack has a front door, open the door.**
4. **Loosen the four screws that secure the top panel to the rack.**
5. **Slide the top panel toward the front of the rack and lift it up to remove it from the rack.**

To replace the top panel, reverse the order of the removal procedure.

Removing and Replacing a Power Sequencer

1. Loosen captive screws on the front of the power sequencer.
2. Pull the power sequencer part of the way out of the rack.
3. Disconnect three cables from the rear panel of the power sequencer.
4. Pull the power sequencer free from the cables and out of the rack.

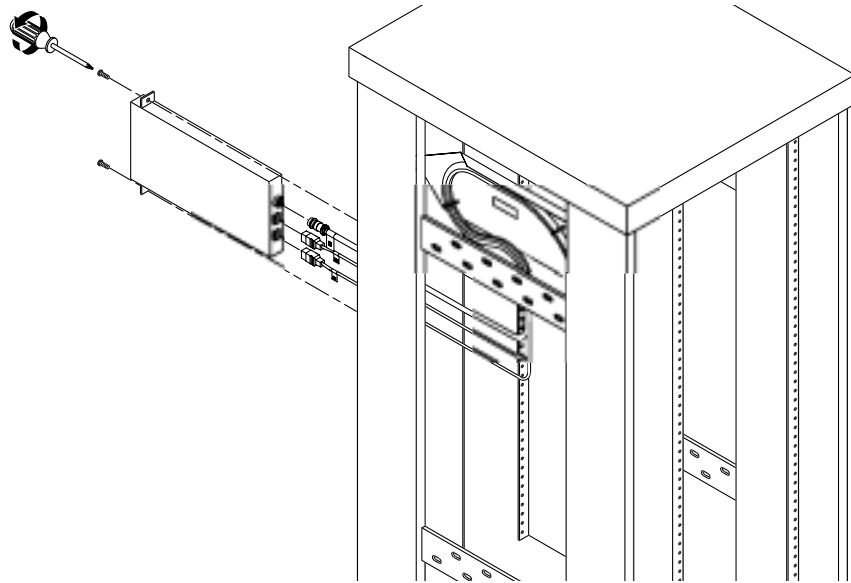


FIGURE 1-3 Removing a Power Sequencer

To replace a power sequencer, reverse the steps of the power sequencer removal procedure.

Removing and Replacing a Power Strip

In order to remove the inner power strip, you must first remove the outer power strip (the one closer to the back of the rack). The removal procedure for both power strips is the same.

1. **Disconnect the cable from the bottom of the power strip.**
2. **Loosen the retaining screw at the top of the power strip and pull the top of the power strip toward the back of the rack.**
3. **Pull the power strip up and out so that the tab at the bottom of the power strip clears the bracket.**

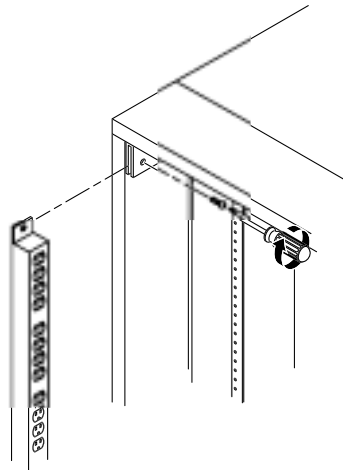


FIGURE 1-4 Power Strip

To replace a power strip, reverse the steps of the power strip removal procedure.

To replace the inner power strip, the outer power strip must be removed.

Removing and Replacing a Cable Assembly

Removing a Cable Assembly

1. Disconnect the cable harness to be removed from its power strip.
2. On the power sequencer side of the rack, remove the side panel, the power strip bracket cover, the power strip bracket, and both power strips.

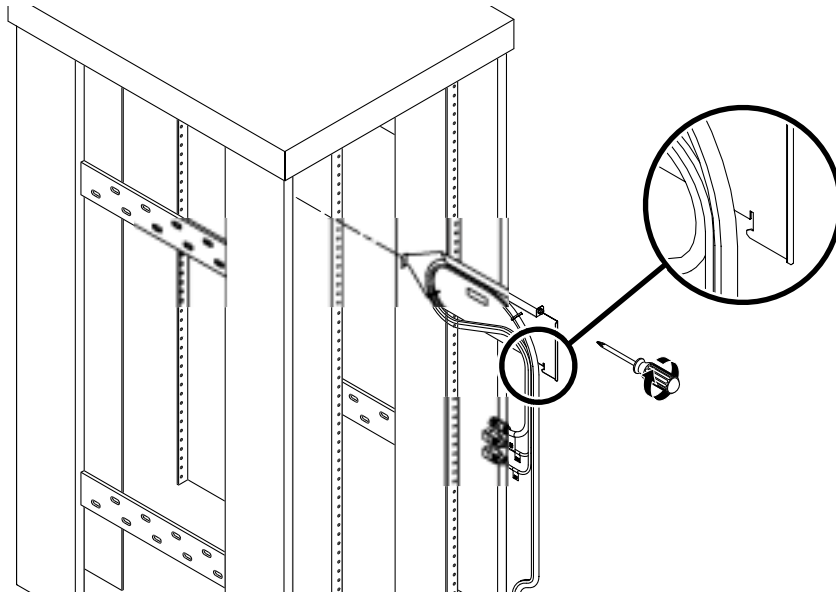


FIGURE 1-5 Cable Harness

3. Disconnect the cable harness from the power input panel.
 - a. Remove two screws holding the power input panel to the rack.
 - b. Remove one screw that holds the connector cluster to the power input panel assembly.
4. Disconnect the cable harness from the power sequencer.
 - a. Loosen two screws on the front panel of the power sequencer.

- b. **Pull the power sequencer out the front of the rack.**
- c. **Disconnect the cable harness from the three connectors on the power sequencer. Set the power sequencer aside.**
5. **Loosen the screw that holds the cable harness carrier plate to the rack.**
6. **Lift up the rear of the carrier plate so the notch clears the edge on which it is seated.**
7. **Pull the carrier plate and cable harness out the back of the rack.**

Replacing a Cable Assembly

Each cable harness consists of three cables bundled together on a carrier plate. Viewed from the back of the rack, the cable harnesses and power sequencers are mounted on the left side of the rack. The lower cable harness (B) is shorter than the upper harness (A). Each cable carrier plate is installed in the slot above its respective sequencer. It is more convenient to install the cables for the lower sequencer (B) first.

1. **Remove the rack side panel, the power strip bracket cover, and the power strip bracket.**

2. Holding the carrier plate, pass the cable bundle through the space between the outer frame and the rack mounting rail.

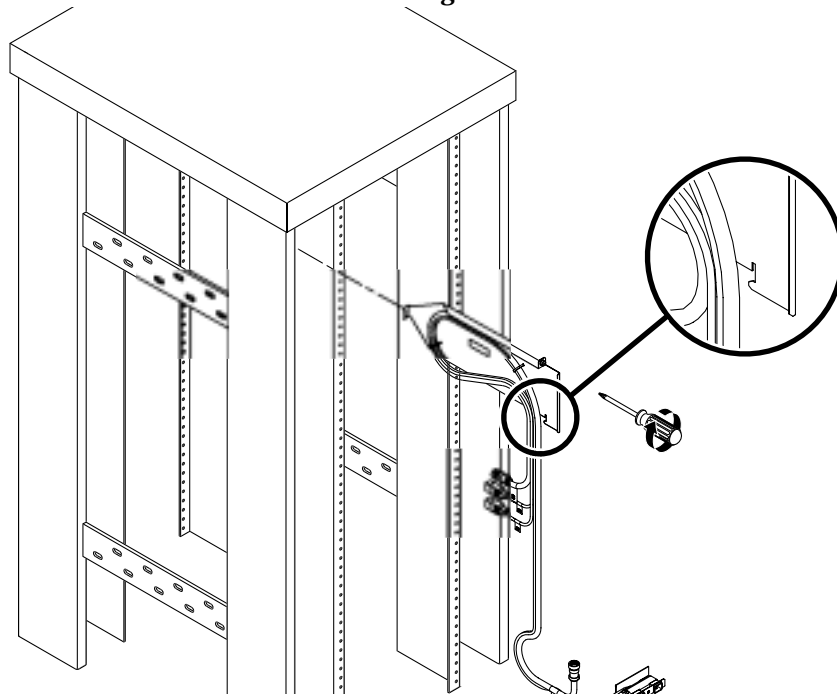


FIGURE 1-6 Cable Harness and Carrier Plate

After the cable ends are inserted, insert the carrier plate and push it forward toward the front of the rack. As you slide the carrier plate in, the front end is guided by a vertical channel on the front cover plate.

As the carrier is close to being fully inserted, a small tab on its bottom edge aligns with a slot in the channel to position the carrier to the right. As this tab fully engages a small vertical slot in the carrier plate engages and allows the carrier to drop into its final position. At this point tighten the captive screw.

3. Repeat Step 2 for the upper cable harness (A).

4. Attach the two connector clusters to the power input panel.

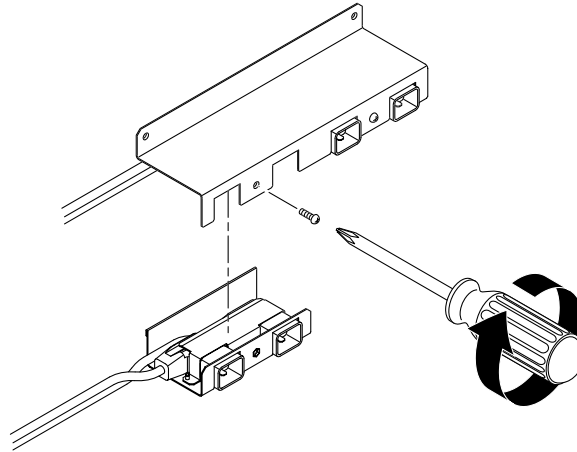


FIGURE 1-7 Attaching Connector Clusters to the Power Input Panel

Mount the lower cable harness cluster (B) on the right side of the input panel.

Position each cluster under the power input panel with the open side up. The cables are positioned on the left side of the power input panel. The connectors engage with the slots in the front surface. Secure each cluster with a single screw between the two connectors.

While attaching the left-hand cluster (A) to the power input panel, ensure that the cluster supports the two cables from the right-hand cluster (B).

5. Attach the input power panel to the rack with two 8 mm screws, split washers, and flat washers.

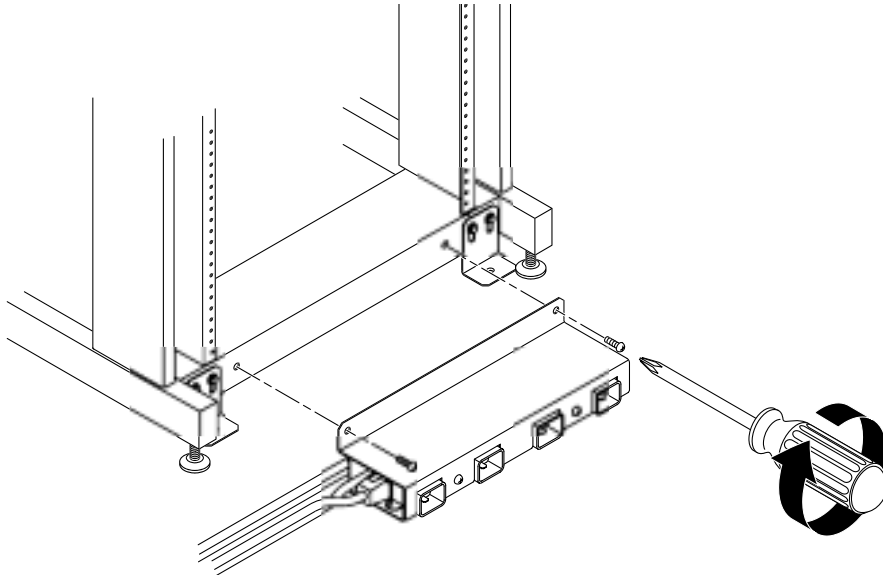


FIGURE 1-8 Attaching the Power Input Panel to the Rack

6. Reinstall the power strip mounting bracket and the power strip mounting bracket cover.

Troubleshooting

Power Sequencer

FIGURE 2-1 shows only one AC circuit in a power sequencer. There are four of these circuits for the odd (1-7) outlet groups and five more for the even (0-8) outlet groups. Outlet Group 9 is unswitched.

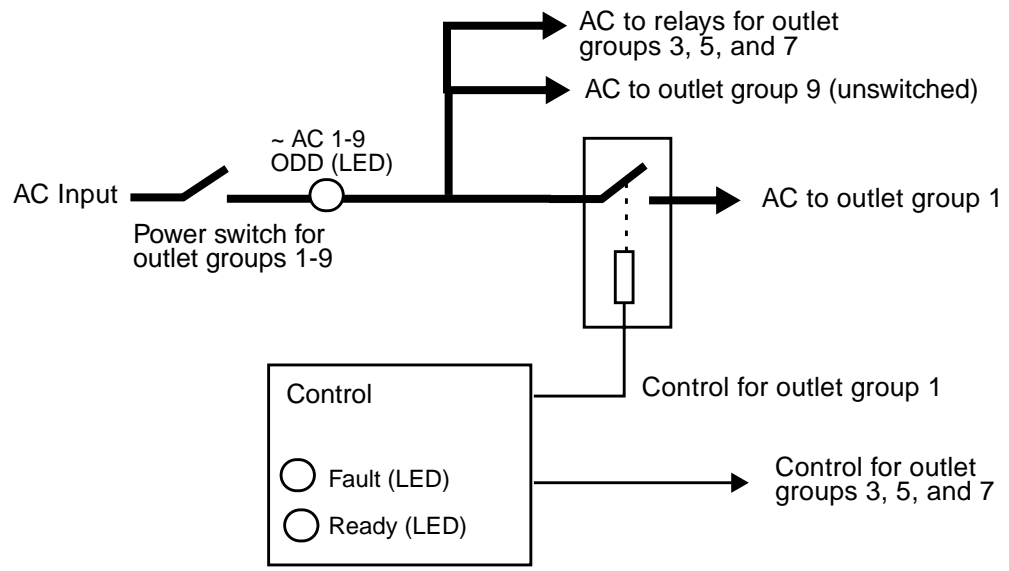


FIGURE 2-1 Simplified Block Diagram of a Single Circuit in a Power Sequencer

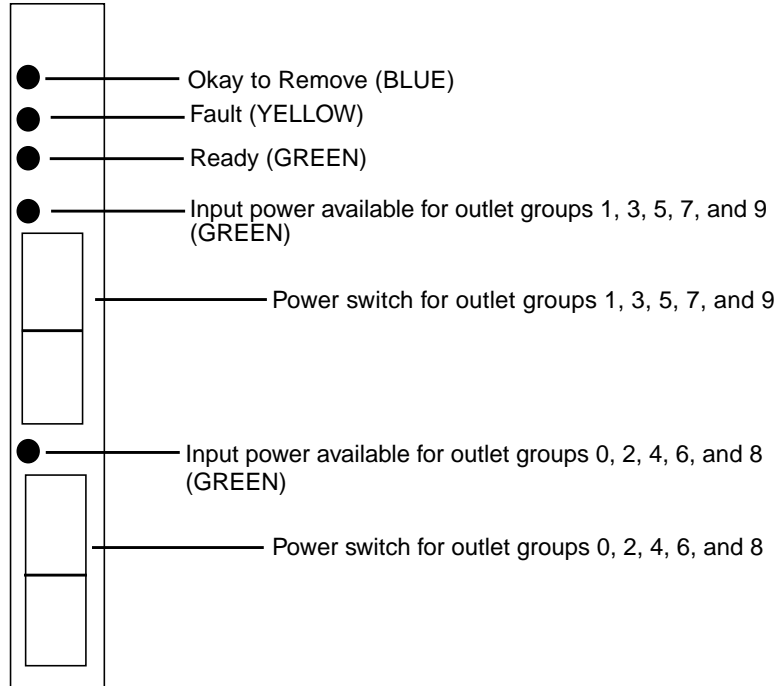


FIGURE 2-2 Power Sequencer LEDs

TABLE 2-1 Sequencer LEDs

LED	ON indicates
Okay to Remove	The sequencer output AC is turned off; there is no power to the power strip outlet groups.
Fault	A problem in the sequencer; either with the sequencer controller or one of the power supplies, or one or more of the outlet groups is not energized. Note: An open (OFF) power switch is not a Fault condition.
Ready	The sequencer is operational and has passed the power-on-self-test (POST).
~ AC 1-9 ODD (Input power available)	AC power is available to the input side of the odd-numbered outlet group relays. Note: this LED only indicates that power is available to the outlet group relays; it does not indicate that AC power is output from the sequencer.
~ AC 0-8 EVEN (Input power available)	AC power is available to the input side of the even-numbered outlet group relays. Note: this LED only indicates that power is available to the outlet group relays; it does not indicate that AC power is output from the sequencer.

TABLE 2-2 LED Indicators on the Power Sequencer

Condition	LED	LED Status	Troubleshooting Action
Normal operation	Okay to Remove	OFF	No action required.
	Fault	OFF	
	Ready	ON	
	~ AC 1-9 ODD	ON	
	~ AC 0-8 EVEN	ON	
Sequencer fault	Okay to Remove	OFF	<ol style="list-style-type: none"> 1. Turn off both power switches. The blue “Okay to Remove” LED lights. 2. Remove and replace the power sequencer.
	Fault	ON	
	Ready	(ON or OFF)	
	~ AC 1-9 ODD	ON	
	~ AC 0-8 EVEN	ON	
Turned off	Okay to Remove	ON	You can safely remove the sequencer.
	Fault	(ON or OFF)	
	Ready	(ON or OFF)	
	~ AC 1-9 ODD	OFF	
	~ AC 0-8 EVEN	OFF	
Missing AC input	Okay to Remove	OFF	Assuming both power switches are on, start troubleshooting the input to the sequencer: <ol style="list-style-type: none"> 1. Input power panel connectors 2. Branch (wall) circuit breaker
	Fault	OFF	
	Ready	ON	
	~ AC 1-9 ODD	OFF	
	~ AC 0-8 EVEN	ON	

Power Strips

Each power strip is divided into outlet groups. Each outlet group has four outlets (sockets). The outlet groups are divided into two sets: odd and even. The odd outlet groups are 1, 3, 5, 7, and 9. The even outlet groups are 0, 2, 4, 6, and 8. The odd outlet groups receive their power from one AC input and the even outlet groups receive their power from the other AC input.

The power strips have a power indicator LED for each outlet group.

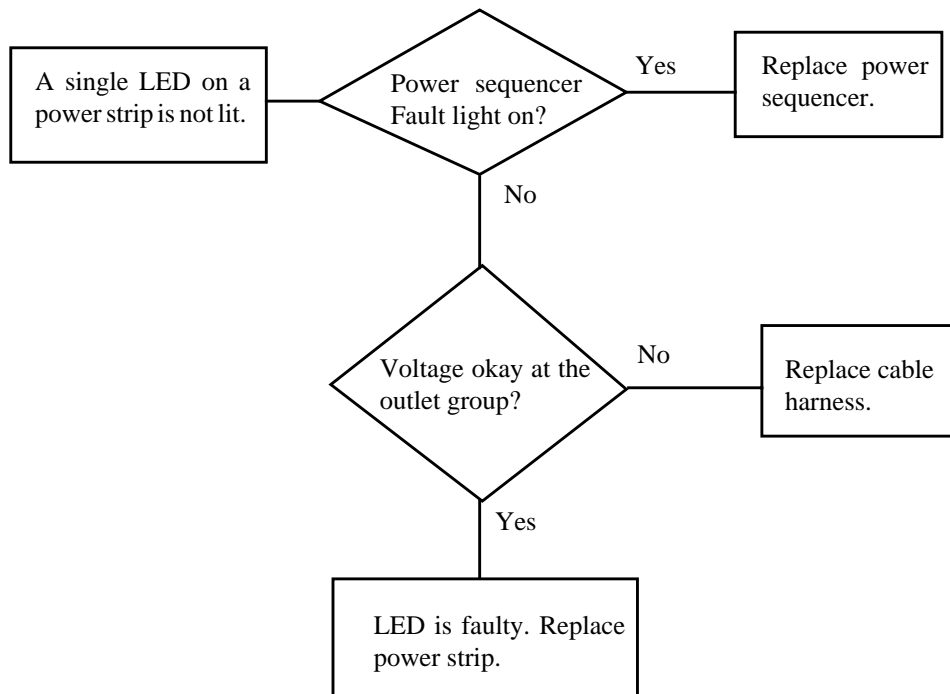


FIGURE 2-3 Troubleshooting a Power Strip